

Presented By
Clermont County Water



ANNUAL
WATER
QUALITY
REPORT

WATER TESTING PERFORMED IN 2015

Meeting the Challenge

Once again we are proud to present our annual drinking water report, covering all drinking water testing performed between January 1 and December 31, 2015. Over the years, we have dedicated ourselves to producing drinking water that meets all state and federal standards. We continually strive to adopt new methods for delivering the best-quality drinking water to your homes and businesses. As new challenges to drinking water safety emerge, we remain vigilant in meeting the goals of source water protection, water conservation, and community education while continuing to serve the needs of all of our water users.

Please remember that we are always available to assist you should you ever have any questions or concerns about your water.

Benefits of Chlorination

Disinfection, a chemical process used to control disease-causing microorganisms by killing or inactivating them, is unquestionably the most important step in drinking water treatment. By far, the most common method of disinfection in North America is chlorination.

Before communities began routinely treating drinking water with chlorine (starting with Chicago and Jersey City in 1908), cholera, typhoid fever, dysentery, and hepatitis A killed thousands of U.S. residents annually. Drinking water chlorination and filtration have helped to virtually eliminate these diseases in the U.S. Significant strides in public health are directly linked to the adoption of drinking water chlorination. In fact, the filtration of drinking water plus the use of chlorine is probably the most significant public health advancement in human history.

How chlorination works:

Potent Germicide Reduction in the level of many disease-causing microorganisms in drinking water to almost immeasurable levels.


Taste and Odor Reduction of many disagreeable tastes and odors like foul-smelling algae secretions, sulfides, and odors from decaying vegetation.

Biological Growth Elimination of slime bacteria, molds, and algae that commonly grow in water supply reservoirs, on the walls of water mains, and in storage tanks.

Chemical Removal of hydrogen sulfide (which has a rotten egg odor), ammonia, and other nitrogenous compounds that have unpleasant tastes and hinder disinfection. It also helps to remove iron and manganese from raw water.

Important Health Information

Some people may be more vulnerable to contaminants in drinking water than the general population. Immunocompromised persons such as those with cancer undergoing chemotherapy, those who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants may be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. The U.S. EPA/CDC (Centers for Disease Control and Prevention) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline at (800) 426-4791 or <http://water.epa.gov/drink/hotline>.

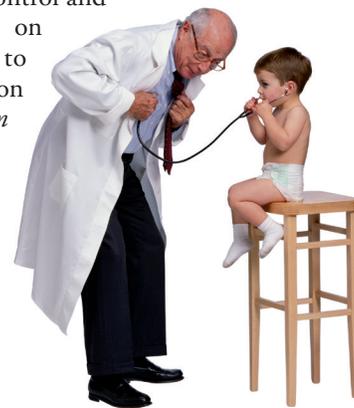

Lead in Home Plumbing

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. We are responsible for providing high-quality drinking water, but we cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at www.epa.gov/lead.

Source Water Description

The Clermont County Water System operates three water treatment plants that pump into a common distribution system of pipes serving our customers.

The MGS plant, located near Miami, draws from wells in the Little Miami River Aquifer. In 2004, the Ohio EPA performed a source water assessment for the MGS wellfield and designated it as highly susceptible to contamination. This designation is based in part on the geology of the aquifer, which is shallow and has little or no impermeable materials atop it. Another factor is the presence of potential sources of pollution in the area. The EPA also notes the presence of nitrates in the water, which suggests man-made influence in the aquifer. However, the water continues to meet drinking water standards. These wellfields are monitored for contamination and cared for under an Ohio-EPA-endorsed Wellhead Protection Plan. To learn more, call Rick Fueston at (513) 553-4113.


The PUB plant is near New Palestine, where its wells draw from the Ohio River Valley Aquifer. A susceptibility analysis from the Ohio EPA has determined that this aquifer has a high susceptibility for contamination, based on a relatively thin layer of low permeability material overlying the aquifer, and the relatively shallow depth of the aquifer. Potential pollution sources in the area and a possible hydraulic connection to the Ohio River also contribute to this assessment. However, the EPA agrees that there is no evidence of existing chemical contaminants in the water. These wellfields are monitored for contamination and cared for under an Ohio-EPA-endorsed Wellhead Protection Plan. To learn more, call Rick Fueston at (513) 553-4113.

The Bob McEwen Water Treatment Plant (BMW), located near Batavia, draws surface water from Harsha Lake, which was created by constructing a dam across the East Fork Little Miami River. Surface water is more susceptible to contamination than groundwater, so extensive testing of the raw water is conducted frequently. Chemical and bacteriological testing, as well as evaluation of the biological organisms living upstream of the lake, is used to determine raw water quality and identify areas of concern. The Ohio EPA completed a source water assessment for BMW in 2004. The protection area around Harsha Lake and the upstream portions of the East Fork Little Miami River includes a number of commercial and industrial facilities, but the greater concern is runoff from agricultural fields, the potential for spills at road and rail crossings, and residential septic systems in the watershed. To learn more, call Tim Neyer at (513) 732-5386. Additional information on the watershed collected by Clermont County is available from the Office of Environmental Quality (OEQ) at (513) 732-7894 or on the Web site: <http://www.oeq.net>. After treatment, which includes Granular Activated Carbon filtration, water from the lake meets all required drinking water standards.

Substances That Could Be in Water

To ensure that tap water is safe to drink, the U.S. EPA prescribes regulations limiting the amount of certain contaminants in water provided by public water systems. U.S. Food and Drug Administration regulations establish limits for contaminants in bottled water that must provide the same protection for public health. Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of these contaminants does not necessarily indicate that the water poses a health risk.

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals, in some cases, radioactive material, and substances resulting from the presence of animals or from human activity. Substances that may be present in source water include:

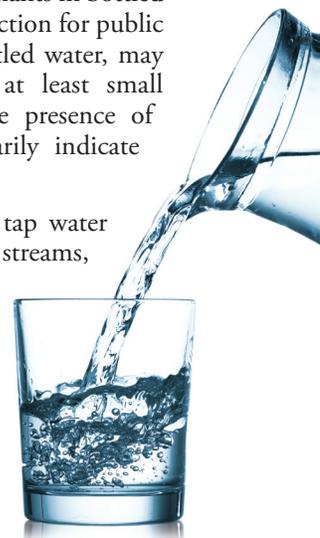

Microbial Contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, or wildlife;

Inorganic Contaminants, such as salts and metals, which can be naturally occurring or may result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming;

Pesticides and Herbicides, which may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses;

Organic Chemical Contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production and may also come from gas stations, urban stormwater runoff, and septic systems;

Radioactive Contaminants, which can be naturally occurring or may be the result of oil and gas production and mining activities.

For more information about contaminants and potential health effects, call the U.S. EPA's Safe Drinking Water Hotline at (800) 426-4791.

QUESTIONS?

Questions about the water system, which has been in operation since 1955, may be directed to Mark Day at (513) 732-7945.

Failure in Flint

The national news coverage of water conditions in Flint, Michigan, has created a great deal of confusion and consternation over the past year. The water there has been described as being corrosive; images of corroded batteries and warning labels on bottles of acids come to mind. But is corrosive water necessarily bad?

Corrosive water can be defined as a condition of water quality that will dissolve metals (iron, lead, copper, etc.) from metallic plumbing at an excessive rate. There are a few contributing factors but, generally speaking, corrosive water has a pH of less than 7; the lower the pH, the more acidic, or corrosive, the water becomes. (By this definition, many natural waterways throughout the country can be described as corrosive.) While all plumbing will be somewhat affected over time by the water it carries, corrosive water will damage plumbing much more rapidly than water with low corrosivity.

By itself, corrosive water is not a health concern; your morning glass of orange juice is considerably more corrosive than the typical lake or river. What is of concern is that exposure in drinking water to elevated levels of the dissolved metals increases adverse health risks. And there lies the problem.

Public water systems are required to maintain their water at optimal conditions to prevent it from reaching corrosive levels. Rest assured that we routinely monitor our water to make sure that what happened in Flint never happens here. For more information on how corrosivity impacts water quality, download this informative pamphlet: <http://goo.gl/KpTmXv>.



Is tap water cheaper than soda?
Yes! You can refill an 8 oz. glass of tap water approximately 15,000 times for the same cost as a six-pack of soda pop. And, water has no sugar or caffeine.

How long can a person go without water?
Although a person can live without food for more than a month, a person can only live without water for approximately one week.

When was drinking water first regulated?
The Safe Drinking Water Act (SDWA) of 1974 represents the first time that public drinking water supplies were protected on a federal (national) level in the U.S. Amendments were made to the SDWA in 1986 and 1996.

Sampling Results

During the past year, we have taken hundreds of water samples in order to determine the presence of any radioactive, biological, inorganic, volatile organic, or synthetic organic contaminants. The tables below show only those contaminants that were detected in the water. The state requires us to monitor for certain substances less often than once per year because the concentrations of these substances do not change frequently. In these cases, the most recent sample data are included, along with the year in which the sample was taken.

We participated in the 3rd stage of the EPA's Unregulated Contaminant Monitoring Rule (UCMR3) program by performing additional tests on our drinking water. UCMR3 benefits the environment and public health by providing the EPA with data on the occurrence of contaminants suspected to be in drinking water, in order to determine if the EPA needs to introduce new regulatory standards to improve drinking water quality. Contact us for more information on this program.

Please note that we have a current, unconditioned license to operate our water system.

REGULATED SUBSTANCES

SUBSTANCE (UNIT OF MEASURE)	YEAR SAMPLED	MCL [MRDL]	MCLG [MRDLG]	AMOUNT DETECTED	RANGE LOW-HIGH	VIOLATION	TYPICAL SOURCE
Barium (ppb)	2015	2,000	2,000	37.1	25.4–37.1	No	Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits
Chlorine (ppm)	2015	[4]	[4]	1.0	0.2–2.9	No	Water additive used to control microbes
Fluoride (ppm)	2015	4	4	1.01	0.64–1.57	No	Erosion of natural deposits; Water additive that promotes strong teeth; Discharge from fertilizer and aluminum factories
Haloacetic Acids [HAAs] (ppb)	2015	60	NA	45.8	ND–68.0	No	By-product of drinking water disinfection
Nitrate (ppm)	2015	10	10	1.14	0.10–2.12	No	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits
TTHMs [Total Trihalomethanes] (ppb)	2015	80	NA	67.8	8.8–94.3	No	By-product of drinking water disinfection
Total Organic Carbon [TOC] ¹ (removal ratio)	2015	TT	NA	1.29	1.10–1.53	No	Naturally present in the environment
Turbidity ² (NTU)	2015	TT	NA	0.36	0.039–0.36	No	Soil runoff
Turbidity (Lowest monthly percent of samples meeting limit)	2015	TT = 95% of samples < 0.3 NTU	NA	99.98	NA	No	Soil runoff

Tap water samples were collected for lead and copper analyses from sample sites throughout the community.

SUBSTANCE (UNIT OF MEASURE)	YEAR SAMPLED	AL	MCLG	AMOUNT DETECTED (90TH%TILE)	SITES ABOVE AL/TOTAL SITES	VIOLATION	TYPICAL SOURCE
Copper (ppm)	2014	1.3	1.3	0.365	0/50	No	Corrosion of household plumbing systems; Erosion of natural deposits
Lead (ppb)	2014	15	0	<5.0	0/50	No	Corrosion of household plumbing systems; Erosion of natural deposits

¹The value reported under Amount Detected for TOC is the lowest ratio between percentage of TOC actually removed to the percentage of TOC required to be removed. A value of greater than 1 indicates that the water system is in compliance with TOC removal requirements. A value of less than 1 indicates a violation of the TOC removal requirements.

²Turbidity is a measure of the cloudiness of the water. It is monitored because it is a good indicator of the effectiveness of the filtration system.

Definitions

AL (Action Level): The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.

LRAA (Locational Running Annual Average): The average of sample analytical results for samples taken at a particular monitoring location during the previous four calendar quarters. Amount Detected values for TTHMs and HAAs are reported as LRAAs.

MCL (Maximum Contaminant Level): The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

MCLG (Maximum Contaminant Level Goal): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

MRDL (Maximum Residual Disinfectant Level): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

MRDLG (Maximum Residual Disinfectant Level Goal): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

NA: Not applicable

ND (Not detected): Indicates that the substance was not found by laboratory analysis.

NTU (Nephelometric Turbidity Units): Measurement of the clarity, or turbidity, of water. Turbidity in excess of 5 NTU is just noticeable to the average person.

ppb (parts per billion): One part substance per billion parts water (or micrograms per liter).

ppm (parts per million): One part substance per million parts water (or milligrams per liter).

removal ratio: A ratio between the percentage of a substance actually removed to the percentage of the substance required to be removed.

TT (Treatment Technique): A required process intended to reduce the level of a contaminant in drinking water.